



No.	By	Date
0	JH	10/20/12
1	JH	8/1/12

App'd	Revision	Submitted / Revision
JH	ISSUED FOR BID	ISSUED FOR BID
JH	FINAL - ISSUED FOR BID	FINAL - ISSUED FOR BID



**NYSEG**  
 GAS BUSINESS UNIT  
 KIRKWOOD, N.Y.

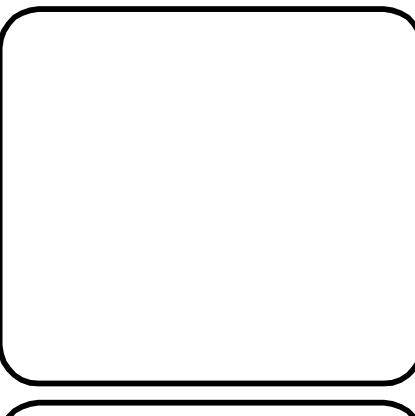

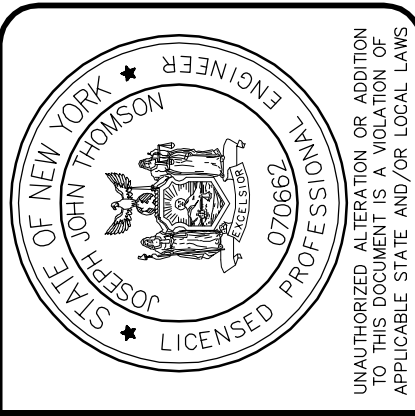Drawing Copyright © 2011  
 International Engineering & Development Corporation  
 Designed: JH  
 Drawn: DDL  
 Checked: JH

**SENECA WEST PIPELINE INTERCONNECT**  
 CIVIL ALIGNMENT PLAN  
 Project No.: 22867  
 Scale: AS SHOWN  
 Issue Date: 04/2012

DWG NO:  
**6172-2101**  
 SHEET 9 OF 29

- NOTES:**
- PIPELINE TO BE INSTALLED WITH MINIMUM OF 48" COVER IN CROPLANDS, 60" IN STREAMS & 36" COVER IN ALL OTHER LOCATIONS. IF BEDROCK IS ENCOUNTERED, THE MINIMUM COVER WILL BE 24".
  - INSTALL PIPELINE UNDER MILLENNIUM GAS PIPELINE & DOMINION GAS TRANSMISSION PIPELINES WITH MINIMUM CLEARANCE OF 24".
  - CONTRACTOR SHALL PROTECT STONE. PRIOR TO CONSTRUCTION ACTIVITIES, STONE SHALL BE COVERED WITH FILTER FABRIC TO PROHIBIT STONE FROM MIXING WITH TRENCH SPOIL. REMOVE FABRIC DURING FINAL RESTORATION.
  - CLEARING ALONG ELECTRIC POWERLINE - CLEAR BRUSH TO THE ROW LIMITS AS SHOWN WITHIN EXISTING POWERLINE ROW. ALL TREES LOCATED OUTSIDE ELECTRIC POWERLINE ROW SHALL BE PROTECTED FROM DAMAGE BY CONSTRUCTION ACTIVITIES. ONLY OVERHANGING LIMBS FROM TREES OUTSIDE THE ELECTRIC POWERLINE ROW THAT COULD BE DAMAGED BY CONSTRUCTION ACTIVITIES MAY BE SIDE TRIMMED.
  - EXTRA WORK SPACE (EWS) AS SHOWN ON DRAWING.
  - REFER TO DWG 6172-2101 SHEET 1 FOR SURVEY NOTES.
  - OPEN-CUT OAK HILL ROAD.
  - ALL WOOD SHALL BE STACKED IN UPLAND AREAS OR REMOVED FROM RIGHT-OF-WAY.
  - CROSS HICKORY GROVE ROAD WITH OPEN CUT.
  - CHECK DAMS, TEMPORARY ACCESS ROADS, STREAM CROSSING, WETLAND CROSSING AND GENERAL EROSION AND SEDIMENT CONTROL DETAILS ARE SHOWN ON SHEETS 12, 13 AND IN THE EM&CS&P.