
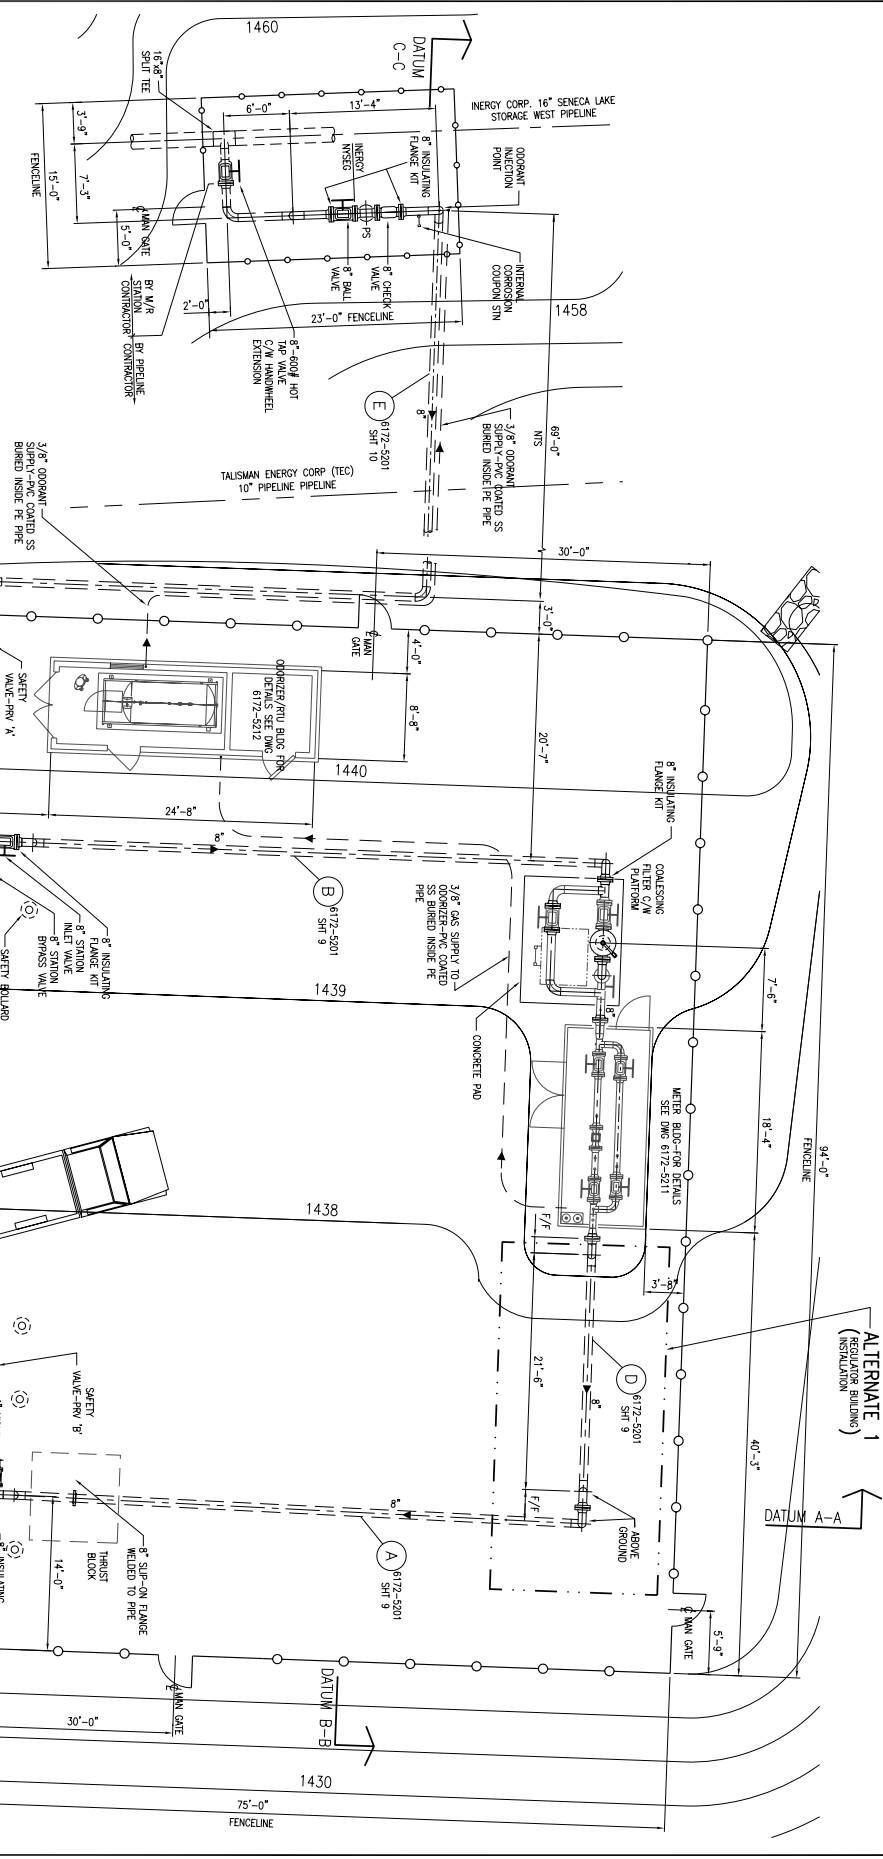


ALTERNATE 1
 ADDITION OF PRESSURE REGULATOR BLOS

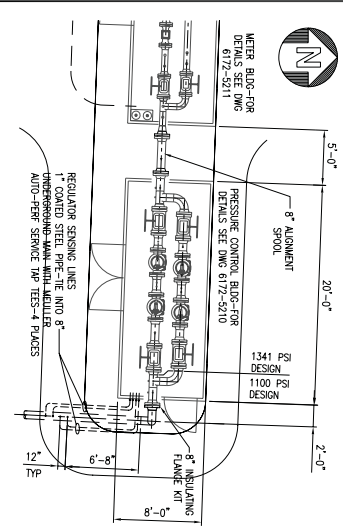

DESIGN CONDITIONS

MAX DAILY FLOW	780	NEW 8" PIPELINE ABOVE GROUND
MAX HOURLY FLOW	3000 USGPH	NEW 8" PIPELINE BERIED
WATER INLET	1341 PSIG	EXISTING PIPELINE
MAX INLET PRESSURE	1341 PSIG	NEW FENCELINE
MAX OUTLET PRESSURE	1100 PSIG	
ANSI CLASS	600#	

SCALE: 3/16" = 1'-0"

SENECA WEST PIPELINE INTERCONNECT

SITE PLAN
 BIG FLAT STATION
 STATION LAYOUT

Issue Date: 12/14/11 Project No.: 23542 Scale: 3/16"=1'-0"

Design: Christopher C. Hill

CHA
AEDC
 International Engineering & Development Corporation

Designed: Drawn: CRG Checked:

UNAUTHORIZED ALTERATION OF ANY PART OF THIS DOCUMENT IS PROHIBITED BY APPLICABLE STATE AND/OR LOCAL LAWS.

NYSEG

GAS BUSINESS UNIT
 KIRKWOOD, N.Y.

No.	Submittal / Revision	App'd	By	Date
PA	ISSUED FOR REVIEW	JH	RM	MAY 2011
PB	ISSUED FOR REVIEW	JH	CRG	OCT 2011
PC	GENERAL REVIEW	JH	CRG	OCT 1911
PD	ISSUED FOR REVIEW	JH	CRG	DEC 14 11
PE	ISSUED FOR REVIEW	JH	CRG	APR 20 12
PF	ISSUED FOR REVIEW	JH	CRG	MAY 01 12
PA	ISSUED FOR BID	JH	CRG	JULY 01 12