


- NOTES:**
- PIPELINE TO BE INSTALLED WITH MINIMUM OF 48" COVER IN CROPLANDS, 60" IN STREAMS & 36" COVER IN ALL OTHER LOCATIONS. IF BEDROCK IS ENCOUNTERED, THE MINIMUM COVER WILL BE 24".
 - STREAM H, I, J & L: PIPELINE CROSSING - DRY METHOD, SEE SHEET 13, 14 AND EM&CS&P.
 - INSTALL WATERBARS & TRENCH BREAKERS AS REQUIRED. AT MINIMUM, NEW WATERBARS SHALL BE INSTALLED TO MATCH EXISTING WATERBARS ACROSS COLUMBIA GAS TRANSMISSION RIGHT-OF-WAY.
 - INSTALL ROCK PAD AT ROAD EDGE FOR ACCESS TO/FROM ROW, SEE SHEET 13, 14 AND EM&CS&P.
 - REFER TO DWG 6172-2101 SHEET 1 FOR SURVEY NOTES.
 - OPEN-CUT WOOD GATE DRIVE.
 - OPEN-CUT PROSPECT HILL ROAD.
 - ALL WOOD SHALL BE STACKED IN UPLAND AREAS OR REMOVED FROM RIGHT-OF-WAY.
 - EXTRA WORK SPACE (EWS) AS SHOWN ON DRAWING.
 - FOREIGN PIPE CROSSING - INSTALL PIPELINE BELOW 12" COLUMBIA GAS PIPELINE WITH MINIMUM CLEARANCE OF 24".
 - CHECK DAMS, TEMPORARY ACCESS ROADS, STREAM CROSSING, WETLAND CROSSING AND GENERAL EROSION AND SEDIMENT CONTROL DETAILS ARE SHOWN ON SHEETS 13, 14 AND IN THE EM&CS&P.

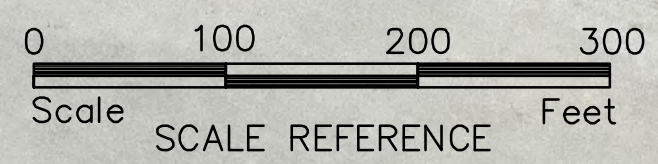

No.	App'd	By	Date
PA	JM	RM	06/09/11
PB	JM	RM	07/20/11
PC	JM	RM	08/17/11
PD	JM	RM	08/31/11
PE	JM	RM	09/02/11
PF	JM	RM	09/05/11
PG	JM	RM	09/15/11

NYSEG
 GAS BUSINESS UNIT
 KIRKWOOD, N.Y.

CIA
IEDC
 International Engineering & Development Corporation

Design: RM
 Checked:
 Scale: 1:100

SENECA WEST PIPELINE INTERCONNECT
 CIVIL ALIGNMENT PLAN
 Project No.: 22867
 Issue Date: 11/2011

File: V:\PROJECTS\NYK2\22867\DATA\OTHER\BASE DRAWINGS_110913\SENECA-6_JMG_CHA.DWG
 Saved: 11/29/2011 9:15:10 AM P:\c:\Users\Markham\Gory\LastSavedBy: 1393