

STATE OF NEW YORK
DEPARTMENT OF PUBLIC SERVICE

CHANGE NOTICE

August 30, 2018

TO: JAMES D. AUSTIN, CHIEF
ENVIRONMENTAL CERTIFICATION & COMPLIANCE SECTION (EC&C)
OFFICE OF ELECTRIC, GAS & WATER

FROM: MATTHEW SMITH, Utility Analyst 2 (Environmental)
Environmental Certification & Compliance Section

SUBJECT: CASE 10-T-0080 - Application of Niagara Mohawk Power Corporation d/b/a National Grid for a Certificate of Environmental Compatibility and Public Need Pursuant to Article VII for the Construction of a New 115kV Electric Transmission Line from Spier Falls, Saratoga County to Rotterdam, Schenectady County - Sodeman Road Amendment.

RECOMMENDATION: Approval of Change Notice 4 as Requested

*** *** ***

In accordance with Ordering Clause 27(a) of the Joint Proposal Ordering Clauses in the Environmental Management and Construction Plan (EM&CP) and Commission's Certificate, issued and effective in this case on February 24, 2011, Niagara Mohawk Power Corporation d/b/a National Grid (National Grid or the Company), has notified Staff of a change to its EM&CP (see attachments).

Change Notice 4 - Request to installing fencing around the project marshaling yard. By the installation of the fencing the project's materials and equipment will be stored in a more secure manner.

Environmental Staff has reviewed the proposed change and believes that it would not result in any net increase in adverse environmental impacts associated with this project and is

not directly related to any issues contested during the proceedings. We recommend that this change be approved and National Grid be so notified.

REVIEWED & APPROVED:



James D. Austin, Chief, EC&C
Office of Electric Gas & Water

cc: Joe W. Stadelmeyer, Joseph.Stadelmeyer@nationalgrid.com
David Morrell, NYDPS
10-T-0080 Case File
DPS Central File

Attachments

**Niagara Mohawk Power Corporation –d/b/a National Grid
Environmental Management & Construction Plan
Notice of Minor Change**


Project: Sodeman Road Substation **Notice Number:** 04
PSC Case Number: 10-T-0080 Sodeman Road Substation Amendment
USACE Permit Number: N/A
Project Drawings / Sheets: _____
Other Drawings: See below
Location: Marshalling yard
Feature Changed: Security fencing
Description of Change: Security fencing installation around the marshalling yard. National Grid has determined that fencing is needed for the marshalling yard (EMCP Condition Section III 1(g)). Approximate fence location shown in sketch below. Fence cut sheet attached.


Initiated By: Joseph Stadelmeyer **Date:** August 21, 2018

Approvals


NG Transmission Project Engineer:	<u>Rachel Redden</u> <i>RR TAM</i>	Date:	<u>8/21/18</u>
NG Substation Project Engineer:	<u>Maxwell Smith</u> <i>MS TAM</i>	Date:	<u>8/21/18</u>
NG Project Manager:	<u>Joseph Stadelmeyer</u> <i>JS TAM</i>	Date:	<u>8/21/18</u>
NG Manager, Project Management:	<u>Nick Spagnoletti</u> <i>NS TAM</i>	Date:	<u>8/21/18</u>
NG Environmental:	<u>Tracy Miller</u> <i>Tracy Miller</i>	Date:	<u>8/22/18</u>
NG Article VII Director:	<u>Bart Franey</u> <i>BF TAM</i>	Date:	<u>8/21/18</u>
Sent to PSC By:	<i>Tracy Miller</i>	Date:	<u>8/22/18</u>
PSC Approval By:	_____	Date:	_____

Field Sketch

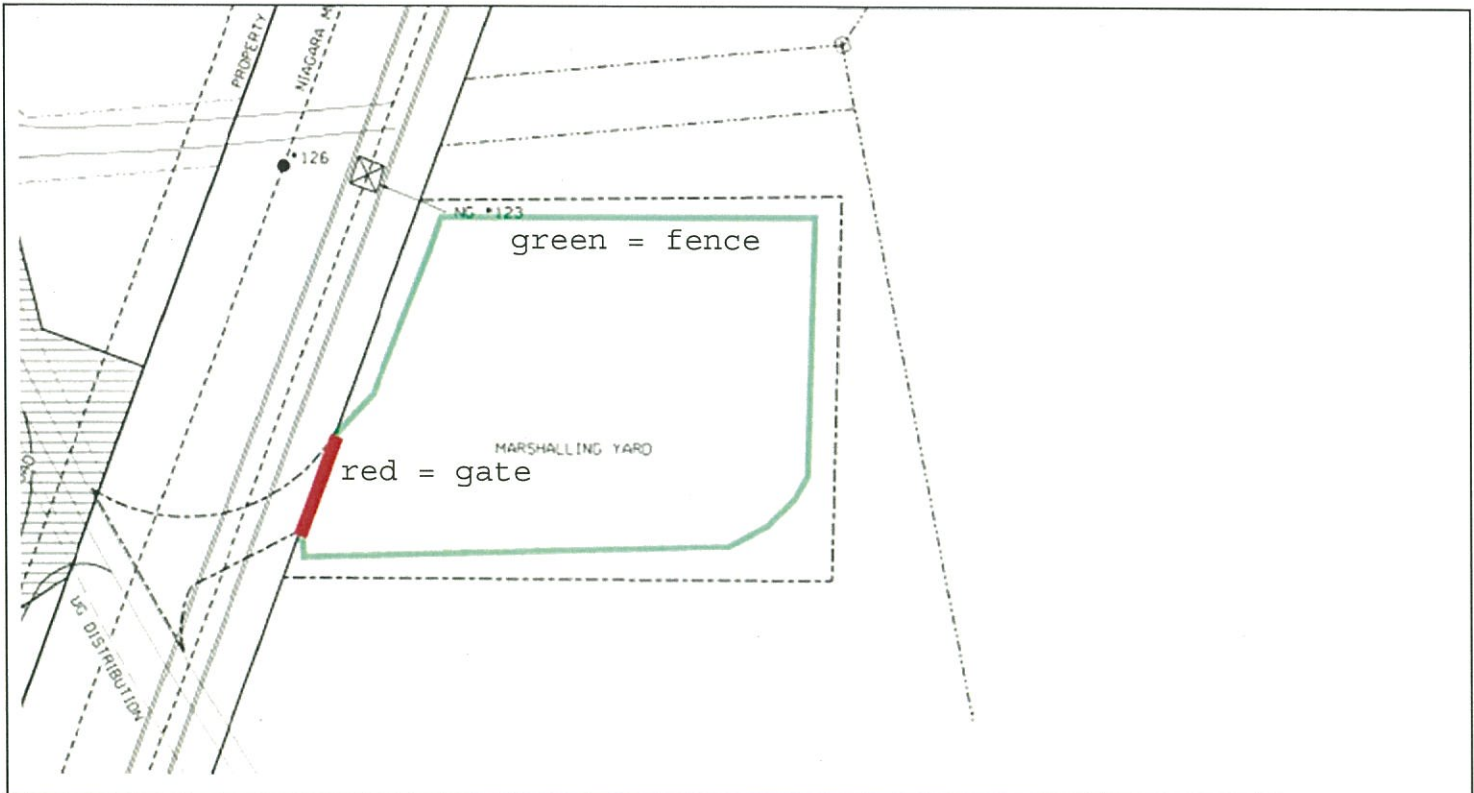

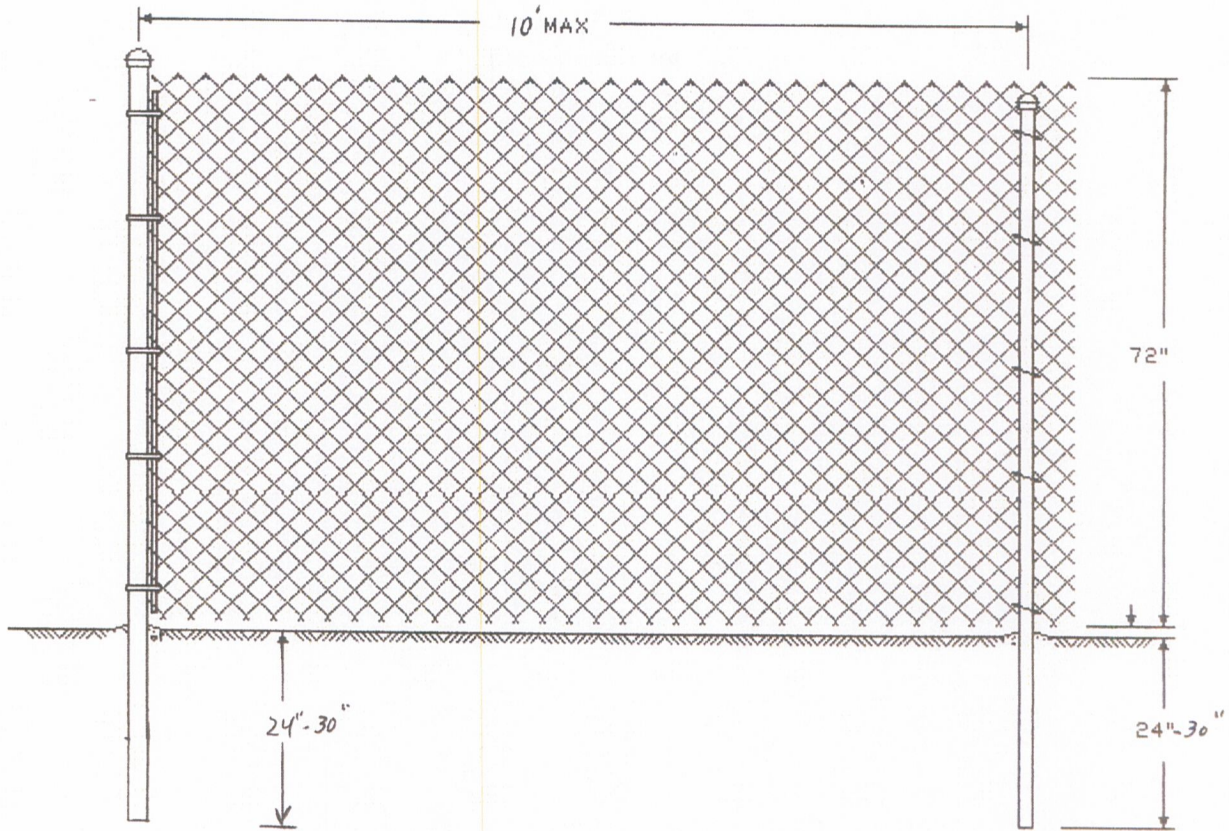

* All posts to be driven only *
* fabric to be 11/2 ga galvanized. *



AFSCO FENCE SUPPLY CO., INC.
185 TROY-SCHENECTADY RD
LATHAM, NEW YORK 12110
(518) 785-0395


TEMPORARY FENCE DETAIL

DRAWN BY: RK 01/25/05	SCALE:	PAGE:
REVISED:	FILE: TEMPORAR	1 of 1

185 Troy-Schenectady Rd
 Latham, NY 12110
 (518) 783-0395

AFSCO
 Fence
 34 Big Boom Rd
 Queensbury, NY 12804
 Saratoga Springs, NY 12866
 (518) 792-7076
 www.afsco-fence.com


Concord Pools Building
 138 South Broadway
 Saratoga Springs, NY 12866
 (518) 691-0344

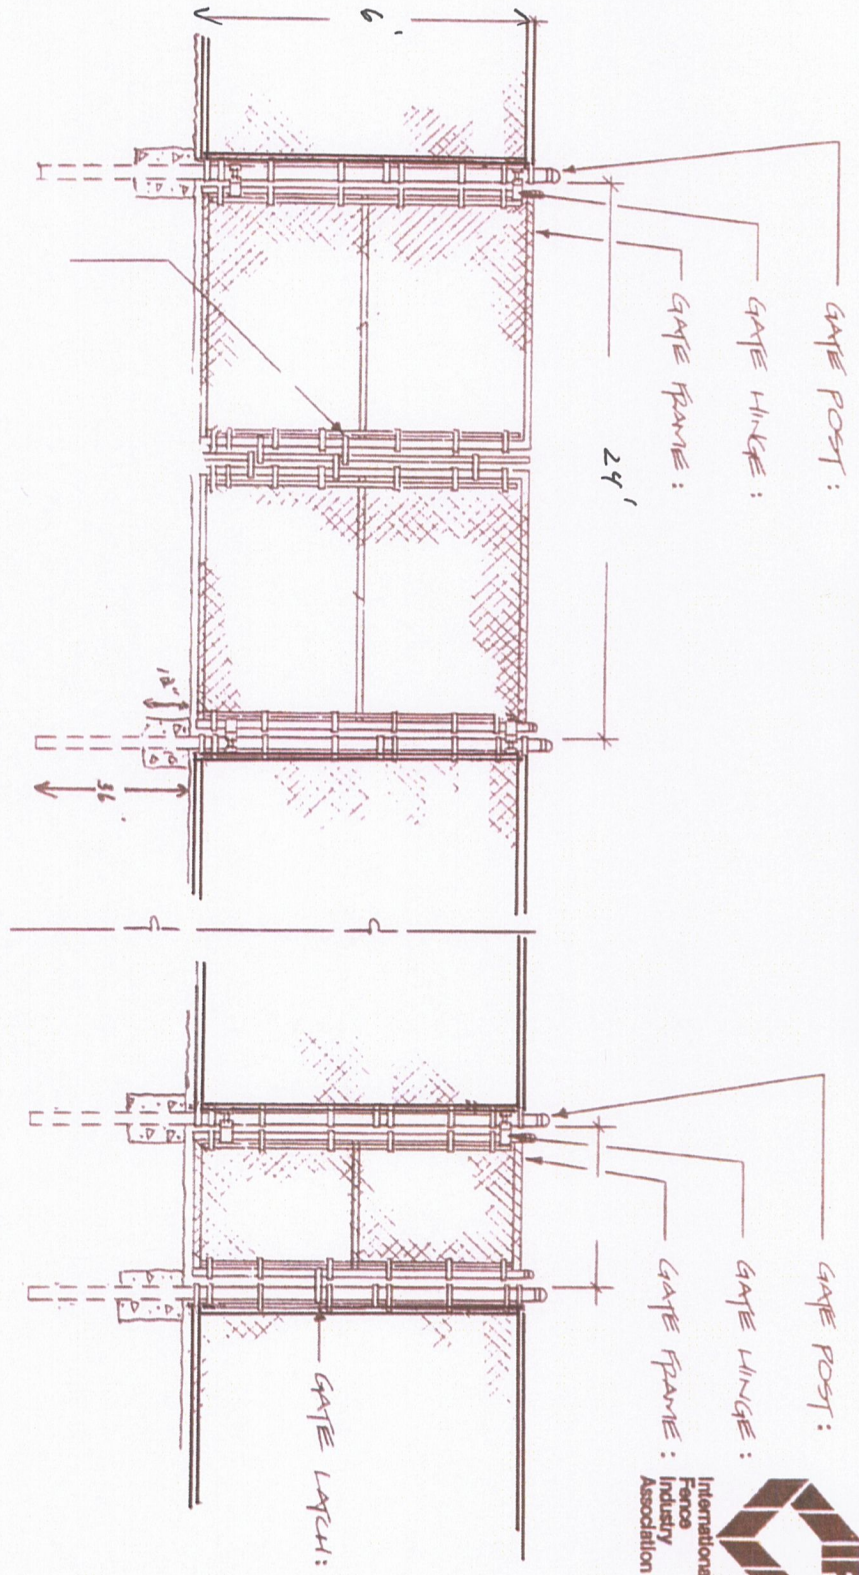

6'- 8' CHAIN LINK GATE DETAILS

STYLE:

NTS

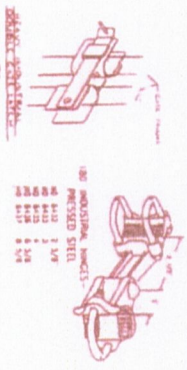

Copyright © IFIA 1992

PROJECT	NMOE	
OWNER / GEN. CON.	Sodeman Road	
SUBMITTED BY		
DRAWING NO.	DATE	2L-17