

CECONY 2016 Rate Cases Walk-through with Parties

April 5, 2016



Demand – Related Functions - Electric


		Functionalization	Allocation
High Tension Demand	Transmission	Direct Assignment	System Peak
	Substation	Direct Assignment	Class Peak
	Primary Feeders	Special Study (minimum system)	Class Peak
	Transformers	Special Study (minimum system)	Average of Class Peak and ICMD
	Secondary Cable	Special Study (minimum system)	Average of Class Peak and ICMD

Cost-of-Service Demand Allocators - Electric

- Transmission Allocator - Class demand at the time of the system peak.
- High Tension Allocator - Peak demand for the class.
- Low Tension Allocator - Weighted average of class peak demand and the sum of the individual customer maximum demands.

Cost-of-Service Demand Allocators - Electric

Calculation of Low Tension Allocator

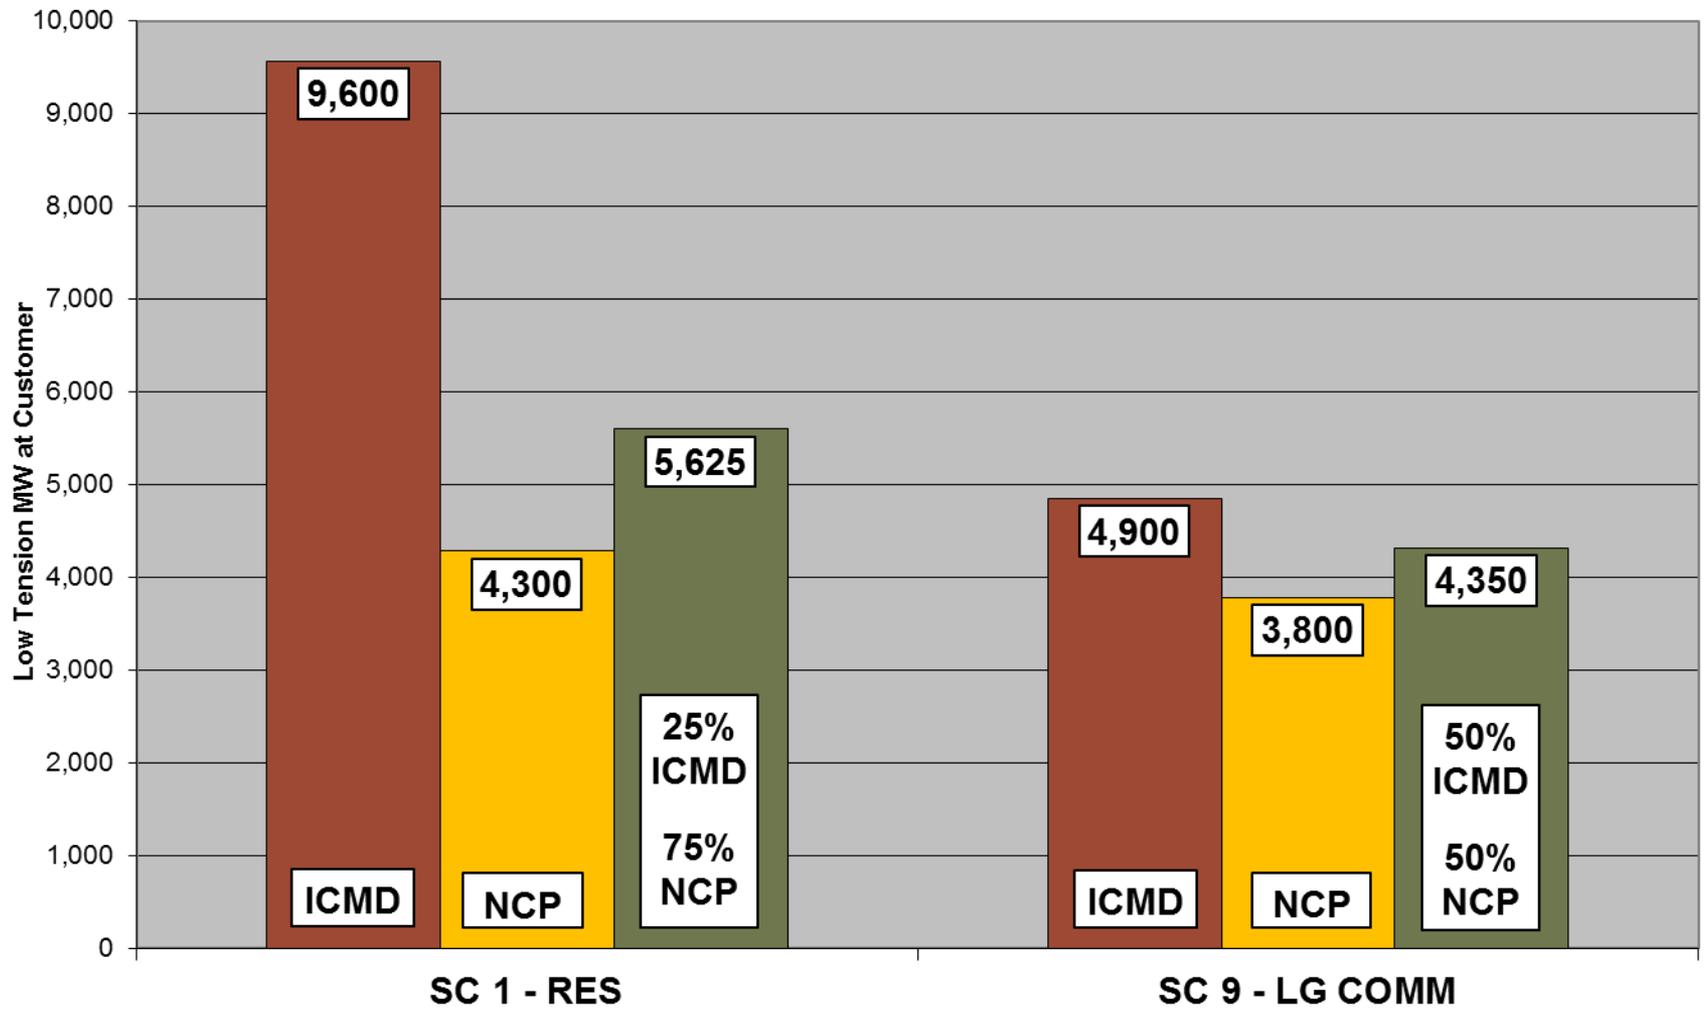

See DAC-1, Schedule 1, Work Paper 3